


STRUCTALL BUILDING SYSTEMS

EPS FOAM CORE ROOF PANELS - METAL SKIN


\\SERVER01\file\cabinet\01 Project Files\Structall Building Systems (STRUCT)\2012-12-STRUC-01_02a Structall EPS Core Panels (FSA).dwg

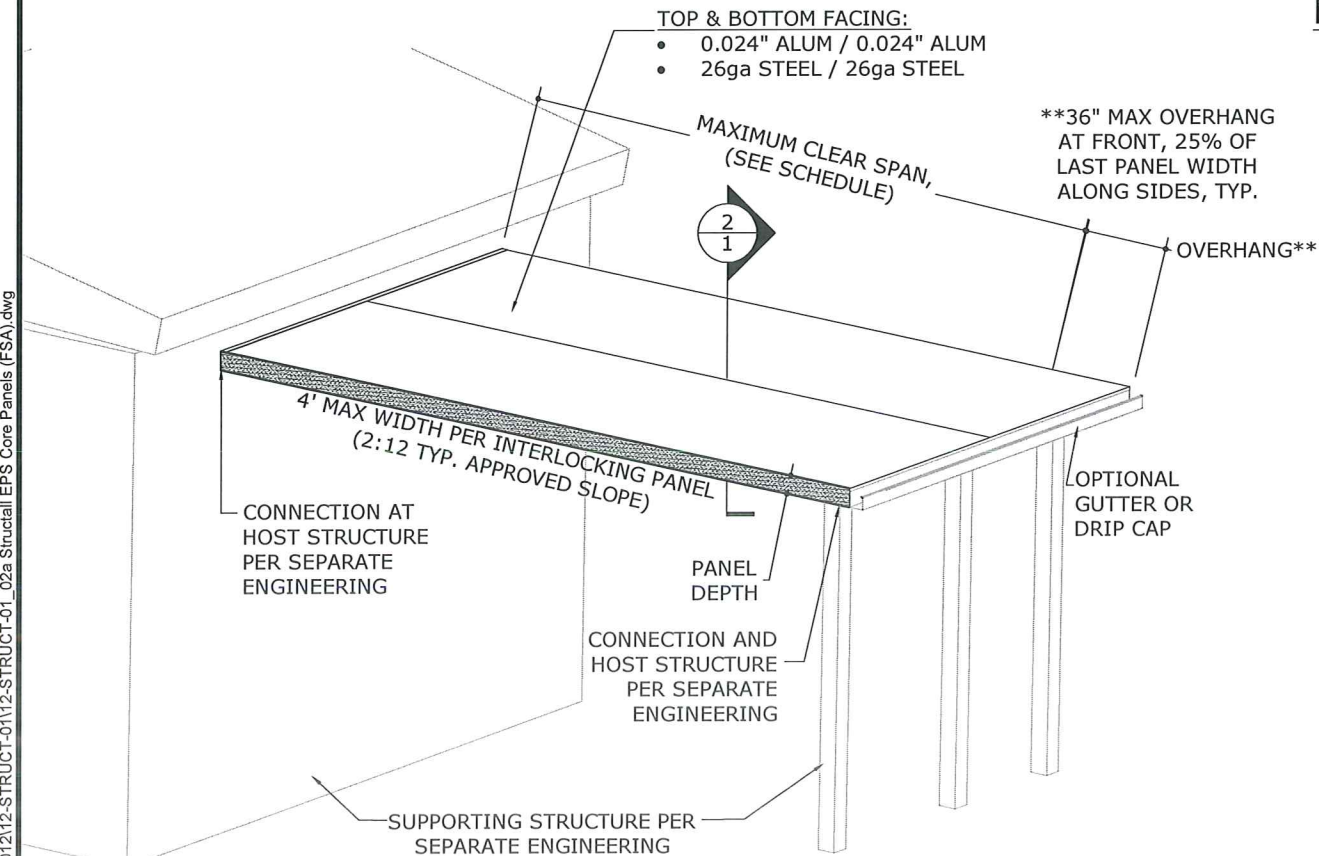

1 CLEAR SPAN ISOMETRIC
N.T.S. ISOMETRIC

MAXIMUM ALLOWABLE CLEAR SPAN TABLE:

| Max Allowable Live Load or Uplift | Deflection Limit (L/...) | 3" Panels | | 4" Panels | | 6" Panels | |
|-----------------------------------|--------------------------|------------------------------|------------------------------|-----------------------------|------------------------------|-----------------------------|--|
| | | 0.024" Alum Skin 1-LB EPS | 0.024" Alum Skin 1-LB EPS | 26ga Steel Skin 1-LB EPS | 0.024" Alum Skin 1-LB EPS | 26ga Steel Skin 1-LB EPS | |
| +/- 10 PSF | 120 | 14'-10" | 17'-6" | 20'-3" | 21'-9" | 23'-0" | |
| +/- 10 PSF | 180 | 12'-12" | 15'-4" | 18'-6" | 19'-0" | 22'-10" | |
| +/- 10 PSF | 240 | 11'-9" | 13'-11" | 16'-10" | 17'-3" | 20'-9" | |
| +/- 15 PSF | 120 | 12'-12" | 15'-4" | 16'-6" | 18'-1" | 20'-5" | |
| +/- 15 PSF | 180 | 11'-4" | 13'-5" | 16'-2" | 16'-7" | 19'-11" | |
| +/- 15 PSF | 240 | 10'-4" | 12'-2" | 14'-8" | 15'-1" | 18'-1" | |
| +/- 20 PSF | 120 | 11'-9" | 13'-11" | 14'-4" | 15'-8" | 17'-8" | |
| +/- 20 PSF | 180 | 10'-4" | 12'-2" | 14'-4" | 15'-1" | 17'-8" | |
| +/- 20 PSF | 240 | 9'-4" | 11'-1" | 13'-9" | 13'-9" | 16'-6" | |
| +/- 25 PSF | 120 | 10'-11" | 12'-9" | 12'-10" | 14'-0" | 15'-10" | |
| +/- 25 PSF | 180 | 9'-7" | 11'-3" | 12'-10" | 14'-0" | 15'-10" | |
| +/- 25 PSF | 240 | 8'-8" | 10'-3" | 12'-5" | 12'-9" | 15'-3" | |
| +/- 30 PSF | 120 | 10'-0" | 11'-8" | 11'-8" | 12'-9" | 14'-5" | |
| +/- 30 PSF | 180 | 8'-12" | 10'-7" | 11'-8" | 12'-9" | 14'-5" | |
| +/- 30 PSF | 240 | 8'-2" | 9'-8" | 11'-8" | 11'-12" | 14'-5" | |
| +/- 35 PSF | 120 | 9'-3" | 10'-9" | 10'-10" | 11'-10" | 13'-4" | |
| +/- 35 PSF | 180 | 8'-7" | 10'-1" | 10'-10" | 11'-10" | 13'-4" | |
| +/- 35 PSF | 240 | 7'-9" | 9'-2" | 10'-10" | 11'-5" | 13'-4" | |
| +/- 39 PSF | 120 | 8'-10" | 10'-3" | 10'-3" | 11'-3" | 12'-8" | |
| +/- 39 PSF | 180 | 8'-3" | 9'-9" | 10'-3" | 11'-3" | 12'-8" | |
| +/- 39 PSF | 240 | 7'-6" | 8'-10" | 10'-3" | 10'-12" | 12'-8" | |
| +/- 45 PSF | 120 | 8'-2" | 9'-6" | 9'-6" | 10'-5" | 11'-9" | |
| +/- 45 PSF | 180 | 7'-10" | 9'-3" | 9'-6" | 10'-5" | 11'-9" | |
| +/- 45 PSF | 240 | 7'-2" | 8'-5" | 9'-6" | 10'-5" | 11'-9" | |
| +/- 50 PSF | 120 | | 9'-0" | 9'-1" | 9'-11" | 11'-2" | |
| +/- 50 PSF | 180 | | 8'-12" | 9'-1" | 9'-11" | 11'-2" | |
| +/- 50 PSF | 240 | | 8'-2" | 9'-1" | 9'-11" | 11'-2" | |
| +/- 55 PSF | 120 | | 8'-7" | 8'-7" | 9'-5" | 10'-8" | |
| +/- 55 PSF | 180 | | 8'-7" | 8'-7" | 9'-5" | 10'-8" | |
| +/- 55 PSF | 240 | | 7'-11" | 8'-7" | 9'-5" | 10'-8" | |
| +/- 60 PSF | 120 | | 8'-3" | 8'-3" | 9'-0" | 10'-2" | |
| +/- 60 PSF | 180 | | 8'-3" | 8'-3" | 9'-0" | 10'-2" | |
| +/- 60 PSF | 240 | | 7'-8" | 8'-3" | 9'-0" | 10'-2" | |
| +/- 65 PSF | 120 | | 7'-10" | 7'-11" | 8'-8" | 9'-10" | |
| +/- 65 PSF | 180 | | 7'-10" | 7'-11" | 8'-8" | 9'-10" | |
| +/- 65 PSF | 240 | | 7'-6" | 7'-11" | 8'-8" | 9'-10" | |
| +/- 70 PSF | 120 | | 7'-3" | 7'-8" | 8'-4" | 9'-5" | |
| +/- 70 PSF | 180 | | 7'-3" | 7'-8" | 8'-4" | 9'-5" | |
| +/- 70 PSF | 240 | | 7'-3" | 7'-8" | 8'-4" | 9'-5" | |
| +/- 78 PSF | 120 | | | 7'-3" | 7'-11" | 8'-11" | |
| +/- 78 PSF | 180 | | | 7'-3" | 7'-11" | 8'-11" | |
| +/- 78 PSF | 240 | | | 7'-3" | 7'-11" | 8'-11" | |
| +/- 80 PSF | 120 | | | | | 8'-10" | |
| +/- 80 PSF | 180 | | | | | 8'-10" | |
| +/- 80 PSF | 240 | | | | | 8'-10" | |
| +/- 85 PSF | 120 | | | | | 8'-7" | |
| +/- 85 PSF | 180 | | | | | 8'-7" | |
| +/- 85 PSF | 240 | | | | | 8'-7" | |
| +/- 90 PSF | 120 | | | | | 8'-4" | |
| +/- 90 PSF | 180 | | | | | 8'-4" | |
| +/- 90 PSF | 240 | | | | | 8'-4" | |
| +/- 95 PSF | 120 | | | | | 8'-1" | |
| +/- 95 PSF | 180 | | | | | 8'-1" | |
| +/- 95 PSF | 240 | | | | | 8'-1" | |

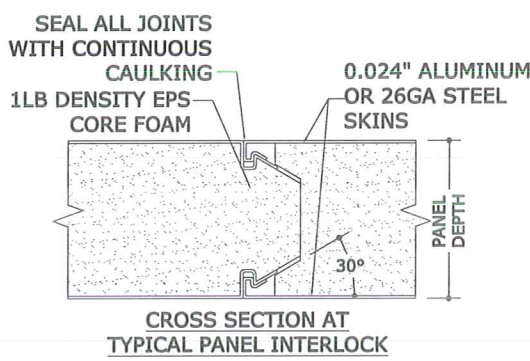

2 PANEL INTERLOCK DETAIL
N.T.S. DETAIL

CLEAR SPAN TABLE USE INSTRUCTIONS:

1. DETERMINE TYPE OF ENCLOSURE TO BE COVERED (OPEN, SCREENED WALLS, OR FULLY ENCLOSED).
2. DETERMINE THE SITE SPECIFIC REQUIRED DESIGN WIND PRESSURE PROVIDED BY SEPARATE ENGINEERING, BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, IN ACCORDANCE WITH THE 2010 FLORIDA BUILDING CODE.
3. FIND ALLOWABLE COMPOSITE PANEL CLEAR SPAN IN TABLES FOR APPROPRIATE PANEL DEPTH, FACING THICKNESS, AND EPS CORE DENSITY SELECTED.
4. INDICATES VALUES NOT VALID FOR USE.

DEFLECTION NOTES:

1. USE L/120 FOR ALL MEMBERS SUPPORTING ROOFS OVER AN OPEN OR SCREEN-WALLED ROOM.
2. USE L/180 FOR ALL MEMBERS SUPPORTING ROOFS WITH A NON-PLASTERED CEILING OVER AN ENCLOSED ROOM.
3. USE L/240 FOR ALL MEMBERS SUPPORTING ROOFS WITH A PLASTERED CEILING OVER AN ENCLOSED ROOM, PER 2010 FBC TABLE 1604.3.

OTHER CONSIDERATIONS:

1. FRONT OVERHANG MAY BE UP TO 3'-0" WITH VALUES LISTED HEREIN. MAXIMUM UNSUPPORTED SIDE OVERHANG IS 25% OF LAST PANEL WIDTH (i.e. 12" MAX FOR 48" PANEL WIDTH).
2. ROOF PITCH SHALL BE 2:12 TYP.

MAXIMUM ALLOWABLE DESIGN PRESSURES:

AS NOTED IN CLEAR SPAN TABLE

DESIGN NOTES:

POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE. SITE-SPECIFIC PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7-10 AND CHAPTER 1609 OF THE 2010 FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.

GENERAL NOTES:

1. THIS SPECIFICATION HAS BEEN DESIGNED AND SHALL BE FABRICATED IN ACCORDANCE WITH THE REQUIREMENTS OF THE 2010 FLORIDA BUILDING CODE FOR USE OUTSIDE THE HVHZ ONLY. COMPOSITE ROOF PANELS SHALL COMPLY WITH CHAPTER 7 SECTION 719, CHAPTER 8 SECTION 803, CLASS A INTERIOR FINISH, AND CHAPTER 26 SECTION 2603 OF THE 2010 FBC.
2. CONTRACTOR SHALL INVESTIGATE AND CONFORM TO ALL LOCAL BUILDING CODE AMENDMENTS WHICH MAY APPLY. DESIGN CRITERIA BEYOND AS STATED HEREIN MAY REQUIRE ADDITIONAL SITE-SPECIFIC SEALED ENGINEERING.
3. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM.
4. DESIGN PRESSURES AS NOTED HEREIN ARE BASED ON A MAXIMUM TESTED PRESSURE DIVIDED BY A 2.0 FACTOR OF SAFETY.
5. THE ARCHITECT/ENGINEER OF RECORD FOR THE PROJECT SUPERSTRUCTURE WITH WHICH THIS DESIGN IS USED SHALL BE RESPONSIBLE FOR THE INTEGRITY OF ALL SUPPORTING SURFACES TO THIS DESIGN WHICH SHALL BE COORDINATED BY THE PERMITTING CONTRACTOR.
6. SEPARATE 'SITE-SPECIFIC' SEALED ENGINEERING SHALL BE REQUIRED IN ORDER TO DEVIATE FROM LOADS, DEFLECTIONS, OR SPANS CONTAINED HEREIN. LINEAR INTERPOLATION OF THE ALLOWABLE SPAN TABLES LISTED HEREIN SHALL NOT BE PERMITTED. CONTACT THIS ENGINEER FOR ALTERNATE SPAN CALCULATIONS AS MAY BE REQUIRED.
7. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
8. THE CONTRACTOR SHALL CAREFULLY CONSIDER POSSIBLE IMPOSING LOADS ON ROOF, INCLUDING BUT NOT LIMITED TO ANY CONCENTRATED LOADS WHICH MAY JUSTIFY GREATER DESIGN CRITERIA. THIS ADDITIONAL ROOF LOAD CRITERIA SHALL BE PROPERLY ANALYZED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT.
9. EPS CORE COMPOSITE PANELS SHALL BE CONSTRUCTED USING TYPE 3105-H254 ALUMINUM FACINGS OR ASTM A653, CS, TYPE B HOT DIP GALVANIZED G90 COATED STEEL FACINGS. EXPANDED POLYSTYRENE FOAM SHALL HAVE TYPICAL DENSITY OF 1.0 PCF. THE EPS FOAM SHALL BE ADHERED TO THE ALUMINUM FACING WITH MORAD M640 SERIES ADHESIVE (BY ROHM AND HAAS COMPANY). FABRICATION SHALL BE IN ACCORDANCE WITH APPROVED FABRICATION METHODS BY MANUFACTURER FOR ALL PANELS.
10. THE CONTRACTOR IS RESPONSIBLE TO INSULATE ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS, I.E. ALUMINUM PER F.B.C. 2003.8.4.
11. ENGINEER SEAL AFFIXED HERE TO VALIDATES STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, et. al. INDEMNIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES INCLUDING LEGAL FEES & APPELLATE FEES RESULTING FROM MATERIAL FABRICATION, SYSTEM ERECTION, & CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE, & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
12. EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED.
13. ALTERATIONS, ADDITIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE THIS CERTIFICATION.

TABLE VALUE DERIVATIONS:

PANEL PROPERTIES:

1. PANEL STRUCTURAL PROPERTIES DERIVED FROM CERTIFIED TEST REPORTS Nos. TT-506027B, 506027C, 506027D, 509014A, 509014B BY TERRAPIN TESTING.
2. PANEL DEAD LOADS HAVE BEEN FACTORED INTO CALCULATIONS FOR LIVE LOADS OR UPLIFT AS WELL AS CALCULATIONS FOR PANEL PROPERTIES.

FRANK L. BENNARDO, P.E.
#PC006549
04/26/2012
No. 46549
ENGINEERING EXPRESS
160 SW 12th AVE, SUITE #300
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGINEERINGEXPRESS.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

STRUCTALL BUILDING SYSTEMS
350 BURBANK ROAD
OLDSMAR, FL 34677
PH: (813) 855-2627

EPS FOAM CORE ROOF PANELS
ALUMINUM & STEEL METAL SKINS
FLORIDA STATEWIDE APPROVAL, FL#15491.1

| DRWN | CHKD | DATE |
|------|------|----------|
| CSL | KL | 04/05/12 |

REMARKS
INITIALS

COPYRIGHT ENGINEERING EXPRESS

12-STRUCT-01
SCALE: NTS 02
PAGE DESCRIPTION:
COVER SHEET